



APPURTENANCE FINISH COLOR
 RUSTOLIUM SUNBURST YELLOW
 BLOW OFF ASSEMBLY
 VALVE CAN LID

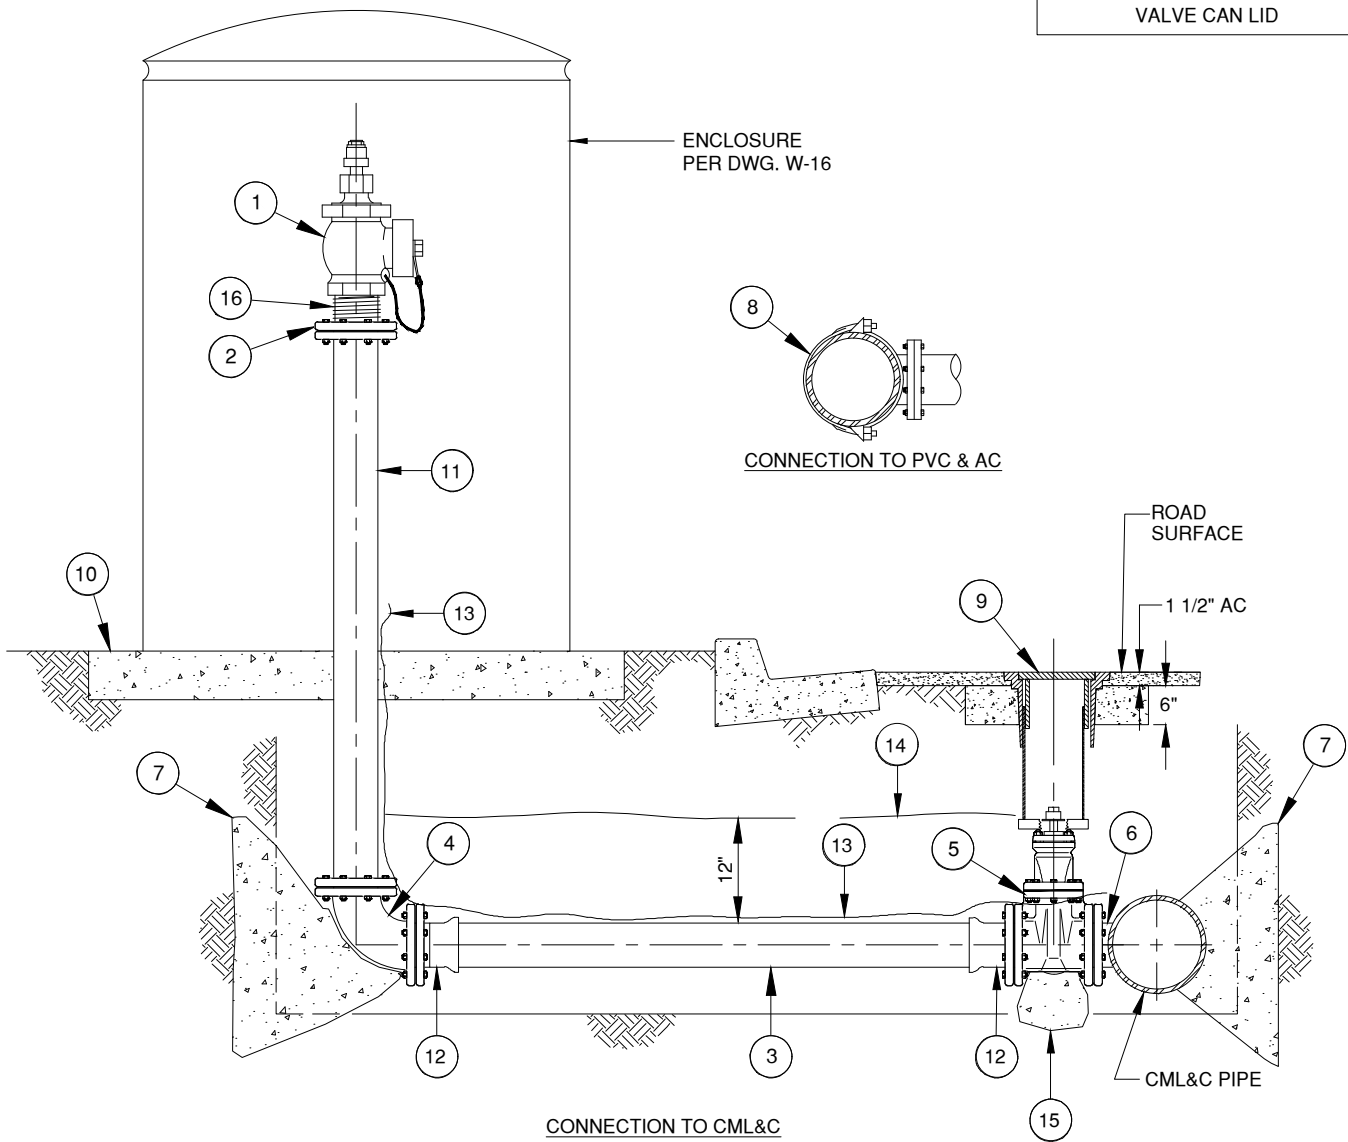


NOTE:
 A. FOR LOCATION OF APPURTENANCES
 SEE STANDARD DRAWING NO. W-2.

● ——— |
 LEGEND ON PLANS

NO.	SIZE & DESCRIPTION	NO.	SIZE & DESCRIPTION
1	4-INCH x 2-1/2-INCH ANGLE FIRE PLUG VALVE, DO NOT PAINT	9	VALVE WELL FRAME, ASSEMBLY, AND VALVE CAN LID PER W-25, PAINT VALVE CAN LID ONLY
2	4-INCH COMPANION FLANGE	10	30-INCH x 30-INCH x 4-INCH CONCRETE PAD
3	4-INCH C900 x REQUIRED LENGTH	11	4-INCH DI x REQUIRED LENGTH, FLG x FLG, PAINT EXPOSED PIPE ONLY
4	4-INCH FLG x FLG 90° BEND	12	4-INCH FLG x PUSH ON OR MJ ADAPTER
5	4-INCH RESILIENT SEATED GATE VALVE (FLG x FLG OR SEE SPEC.)	13	TRACER WIRE
6	4-INCH STEEL FLANGE OUTLET	14	WARNING TAPE
7	CONCRETE THRUST BLOCK, PER W-20	15	VALVE SUPPORT PER W-21
8	MAIN SIZE x 4-INCH DI TEE w/ FLG OUTLET OR TAPPING SLEEVE	16	4-INCH SHORT THREADED BRASS NIPPLE

APPROVED:

 District Engineer Date
 3/2/2026
 Latest Revision Date

 VALLEY CENTER MUNICIPAL WATER DISTRICT
 STANDARD DRAWING
4-INCH BLOW OFF

NOT TO SCALE
 DWG. NUMBER
W-11